
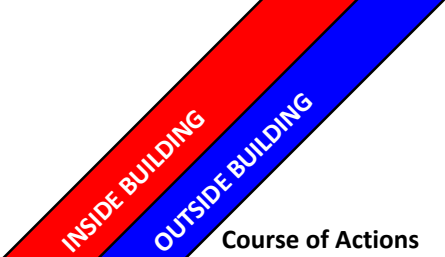
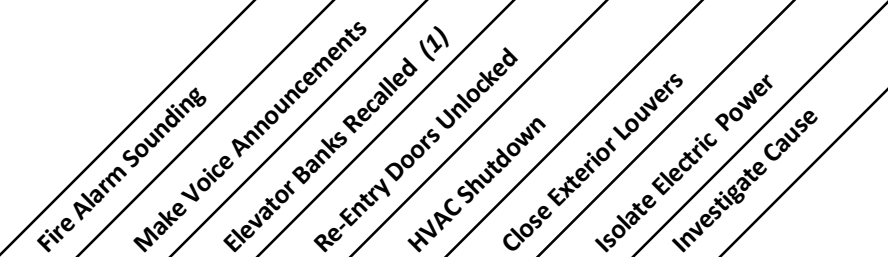



**HIGH-RISE (Office) BUILDING FLSD INITIAL DECISION MATRIX**  
**FCC MANUAL 2-WAY VOICE COMMUNICATION SYSTEM**

Fire and Life Safety Directors Association of Greater New York

**FIRE EVACUATION MODES** **2020**

 <b>FIRE INCIDENTS</b>			<b>Course of Actions</b>									
	Confirmed	Reported		Confirmed	Reported	Confirmed	Reported	Confirmed	Reported	Confirmed	Reported	
<b>Confirmed Fire Condition (4)</b>	X		In-Building Relocation (2)	Y	Y	Y	Y	Y	N	Y	Y	
<b>Fire Condition</b>		X	Shelter-in-Place (3)	N	Y	Y	N	Y	Y	Y	Y	
<b>Confirmed Smoke Condition (4)</b>	X		In-Building Relocation (2)	Y	Y	Y	Y	Y	N	Y	Y	
<b>Reported Smoke Condition</b>	X		Shelter-in-Place (3)	Y	Y	Y	Y	Y	N	Y	Y	
			Ask Fire Warden to call FCC									
<b>Smoke Condition</b>		X	Shelter-in-Place (3)	N	Y	N	N	Y	Y	N	Y	
<b>Fire Alarm Activation</b> <i>(No Visible Fire, Smoke or Odor)</i>	X		After Voice Announcements, Call Activated Floor Fire Warden	Y	Y	N	N	N	N	N	Y	
<b>Odor of Smoke or Smell of Something Burning</b> <i>(Nothing Visible)</i>	X		Floor Tenants Move to Stairwell Fire Brigade Responding	N	Y	N	N	N	N	N	Y	

**NOTE**

<b>1</b>	When an elevator bank is not automatically recalled, manually recall elevator bank to the lobby for a Fire Dept. Response	
	Note: An Elevator bank(cars) will automatically be recalled from the following fire alarm devices:	
	A	Elevator Lobby Smoke Detector
	B	Elevator Machine Room Smoke Detector
	C	Sprinkler Waterflow Device
<b>2</b>	In-Building Relocation: Relocate occupants on the fire floor, floor above and floor below to a Re-Entry floor level	
<b>3</b>	Take necessary building precautions, investigate and monitor the exterior fire/smoke conditions.	
<b>4</b>	Call 911 for a confirmed fire/smoke condition inside the building from:	
	A	Fire Alarm Device Activation
	B	Phone Call from Tenant
	C	Fire Brigade Confirmation
	D	Floor Warden Confirmation